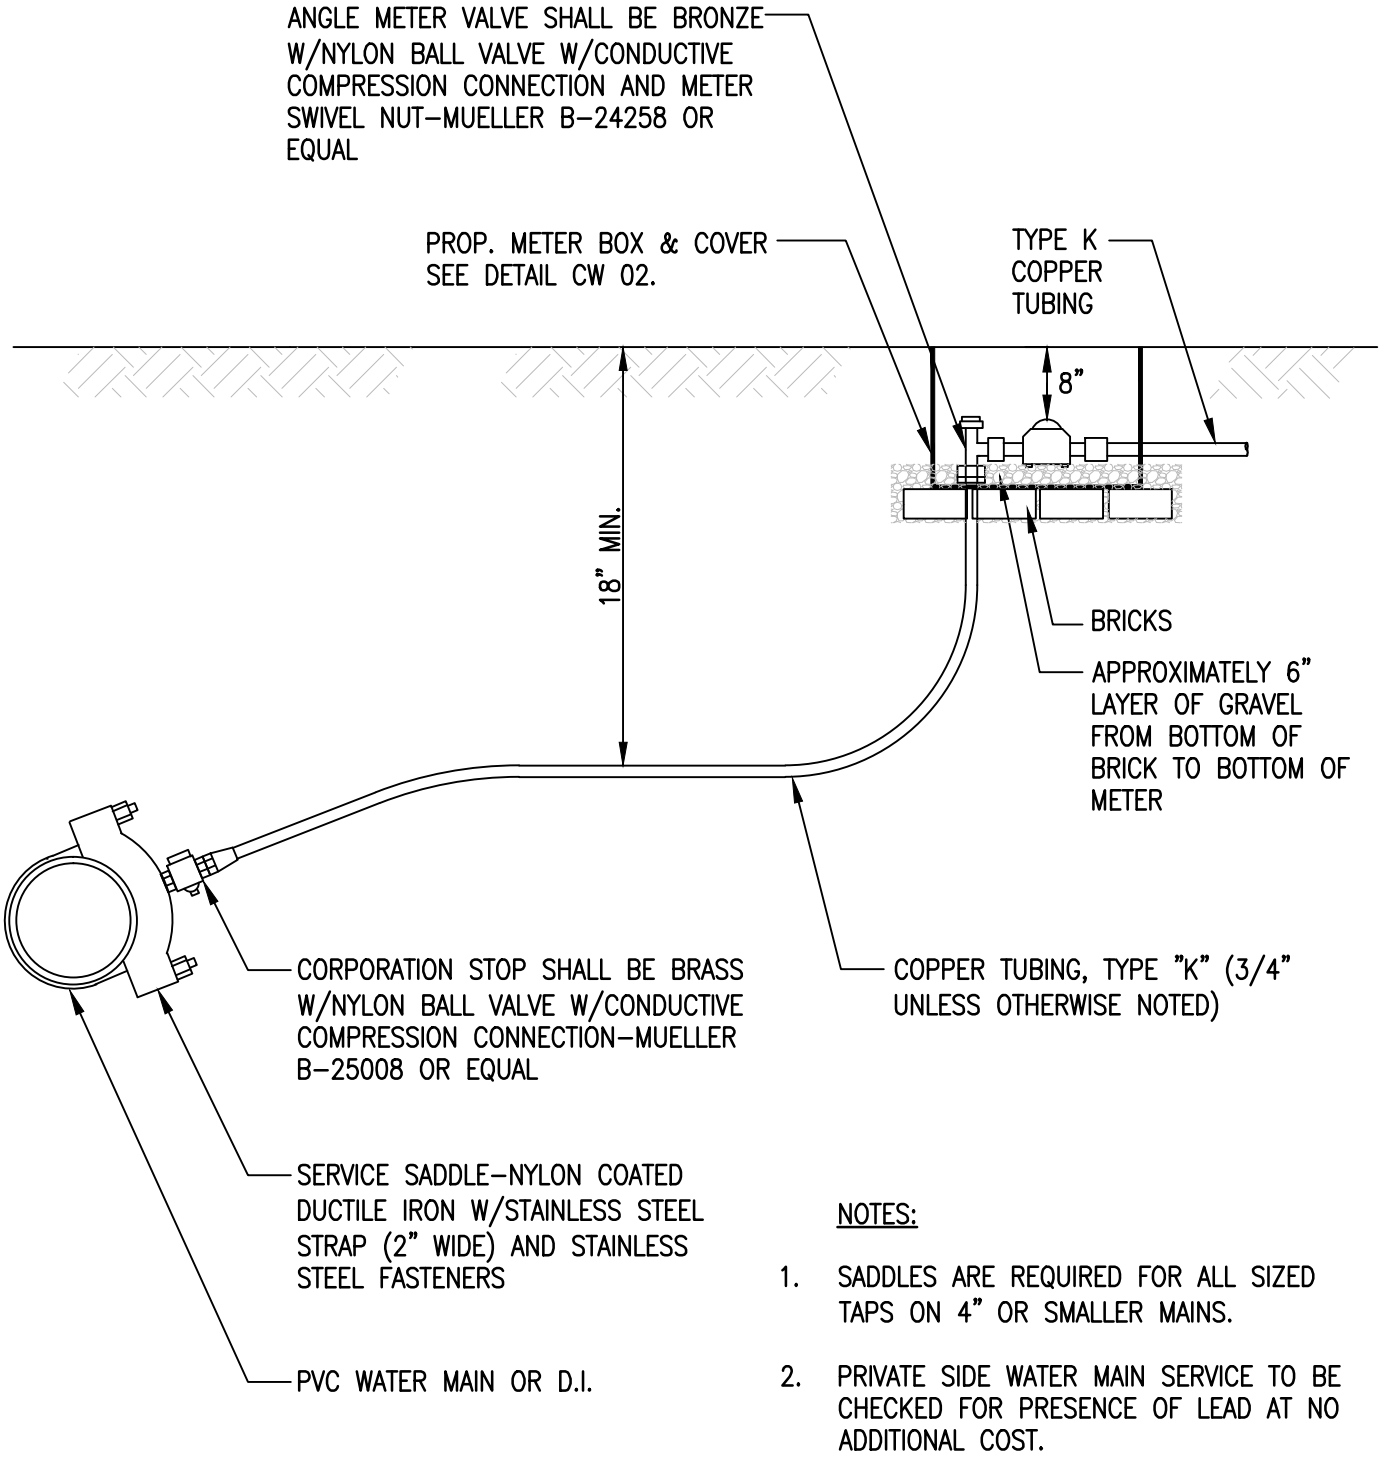

NOTES:

1. SADDLES ARE REQUIRED FOR ALL SIZED TAPS ON 4" OR SMALLER MAINS.
2. PRIVATE SIDE WATER MAIN SERVICE TO BE CHECKED FOR PRESENCE OF LEAD AT NO ADDITIONAL COST.

	CITY OF NORFOLK – DEPARTMENT OF UTILITIES STANDARD DETAILS	SCALE: NOT TO SCALE
DATE: 10/07	TYPICAL TAP INSTALLATION	DRAWING NO. CW 01