



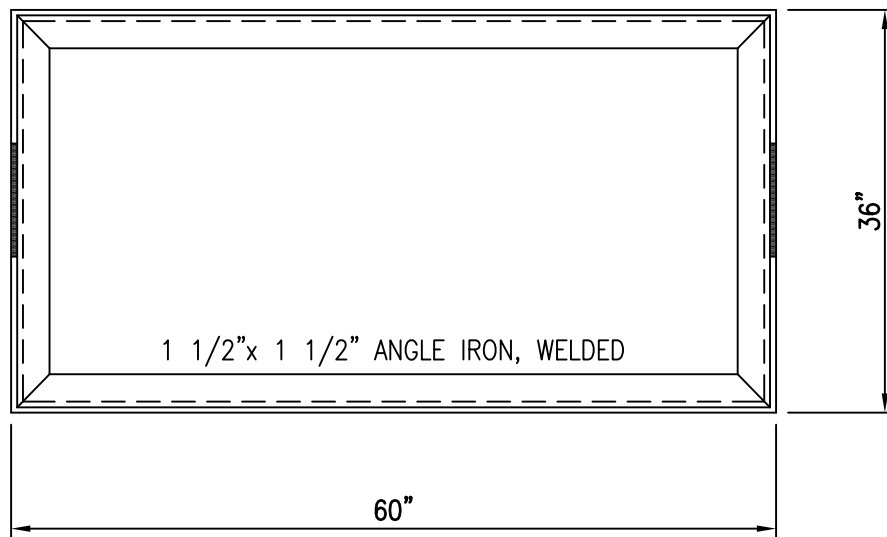

PLAN

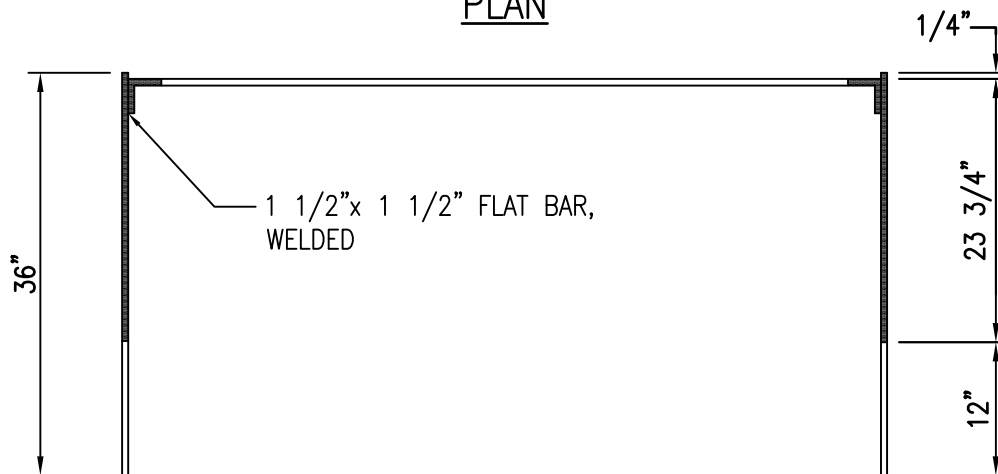

PROFILE

NOTES:

1. SIDES ARE TO BE MADE OF 1/4" MILD STEEL PLATE
2. ALL FOUR CORNERS SHALL BE CONTINUOUS WELDS
3. WATER METER BOX SHALL BE MBX-3660 OR APPROVED EQUAL
4. WATER METER BOX SHALL MEET AASHTO M-306 STANDARDS WITH A MINIMUM RATING OF 30,000 LBS
5. DIMENSIONAL TOLERANCE $\pm 1/16"$
6. METER BOX LOCATION SHOULD NOT BE IN OR ADJACENT TO DRIVEWAYS OR ANY AREA SUBJECT TO VEHICLE LOADS




DATE: 03/24

CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS

3-INCH TO 4-INCH
WATER METER VAULT


SCALE:
NOT TO SCALE

DRAWING NO.
CW 06A

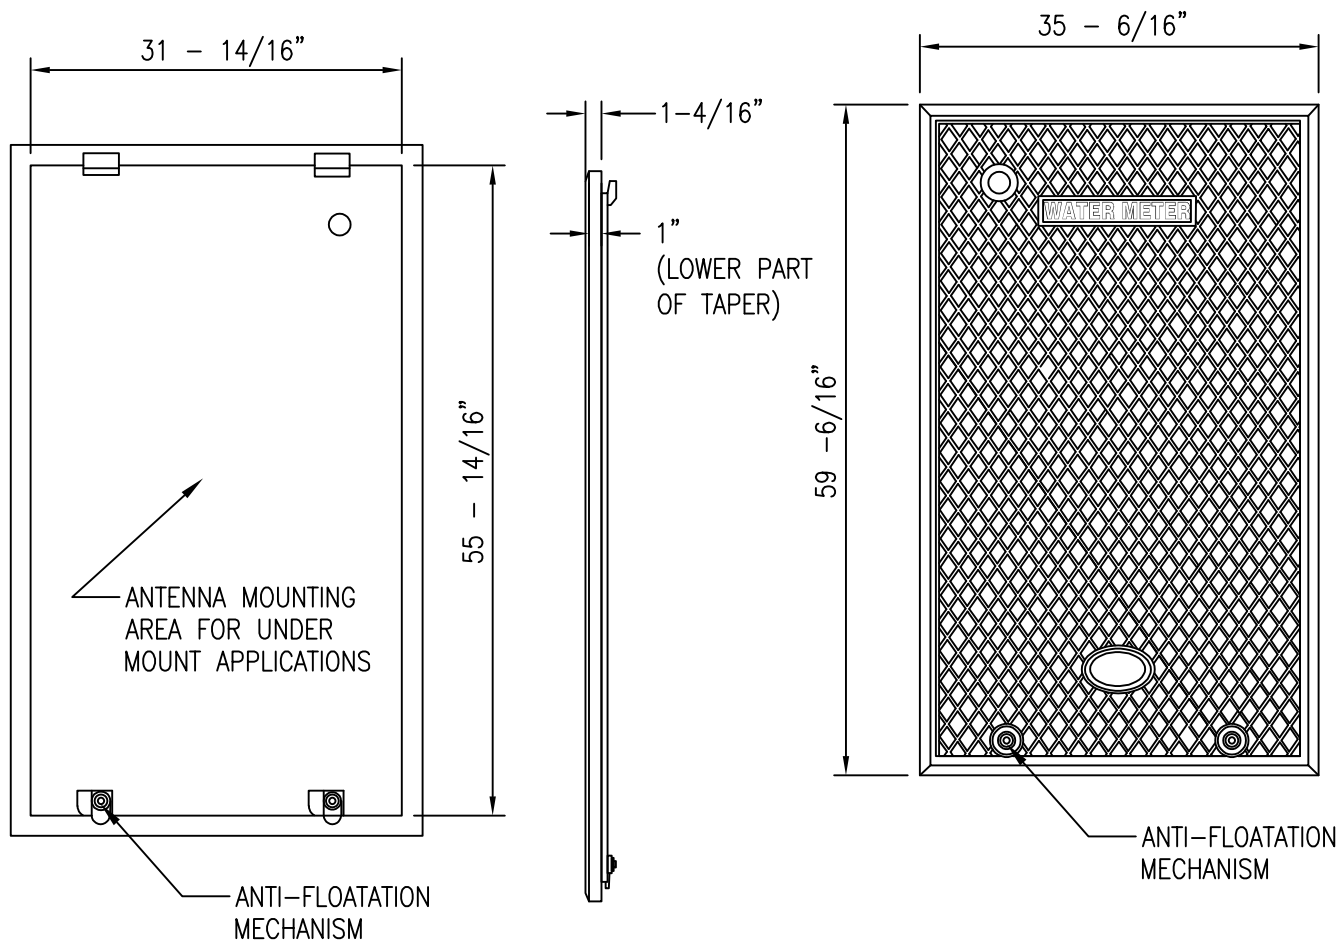

NOTES:

1. MATERIAL: HDPE AND STAINLESS STEEL COMPONENTS
2. WATER METER LID SHALL BE EQUIPPED WITH AN ANTI-FLOATATION MECHANISM.
3. WATER METER LID SHALL MEET AASHTO M-306 LOADING STANDARDS WITH A MINIMUM RATING OF 40,000 LBS.
4. LID MANUFACTURER - TRUMBULL, NICOR OR APPROVED EQUAL
5. DIMENSIONAL TOLERANCE $\pm 1/16"$
6. METER LID LOCATION SHOULD NOT BE IN OR ADJACENT TO DRIVEWAYS OR ANY AREA SUBJECT TO VEHICLE LOADS.



DATE: 07/25

CITY OF NORFOLK - DEPARTMENT OF UTILITIES
STANDARD DETAILS

3-INCH TO 4-INCH
WATER METER VAULT LID

SCALE:
NOT TO SCALE

DRAWING NO.
CW 06B