

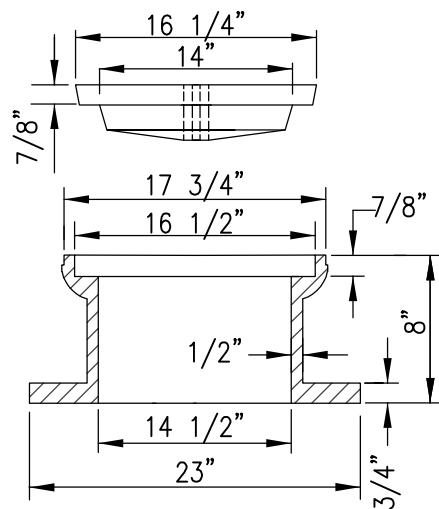


NOTE:

1. GRAVEL BEDDING MAY BE USED IN PLACE OF CONCRETE IN NON-TRAFFIC AREA AT DISCRETION OF ENGINEER.
2. MACHINE SEATING SURFACES ON BOTH COVER & FRAME.
3. ALL CASTINGS TO BE DIPPED IN ASPHALTIC PAINT AFTER MACHINING
4. TOLERANCE TO BE $\pm 0.125"$ FOR ALL DIMENSIONS.
5. CASTINGS TO BE SHOT BLASTED.
6. CASTINGS TO BE ASTM A48 CLASS 35B.
7. COORDINATE VALVE BOX WIDTH WITH SELECTED CHECK VALVE
8. WORD ON COVER SHALL BE "SEWER" WHEN USED IN SANITARY SEWER SYSTEM AND "WATER" WHEN USED IN WATER SYSTEM.
9. WATER TIGHT SEAL SHALL BE ACHIEVED AROUND 2-INCH COPPER PIPE WHERE IT PENETRATES THROUGH BASE.

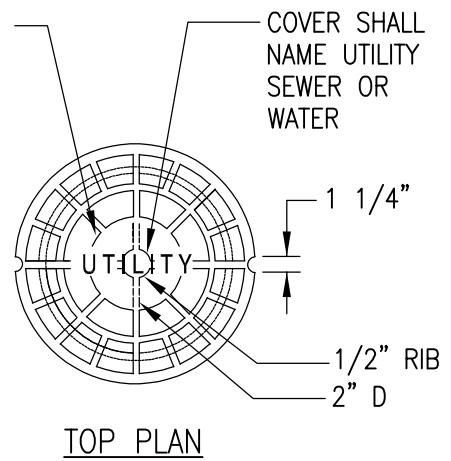

TOP PROFILE



CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS

DATE: 03/18

LEAK DETECTOR

SCALE:
NOT TO SCALE

DRAWING NO.
CWS 02