



PLAN

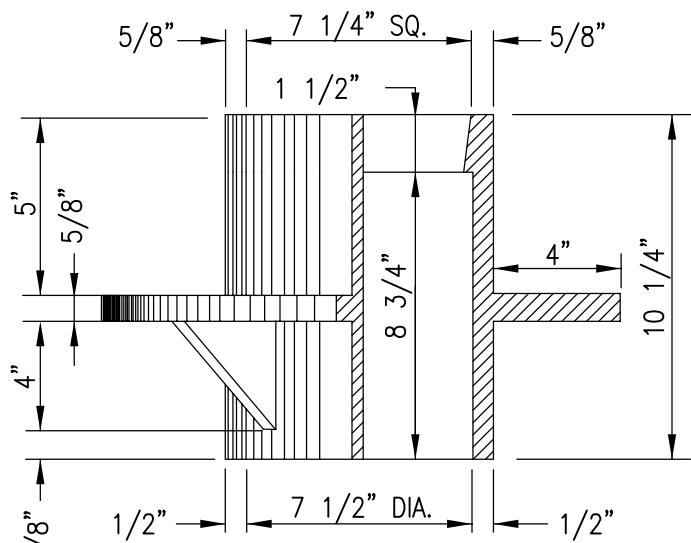

PROFILE

NOTE:

1. LETTER ON COVER SHALL BE "S" WHEN USED IN SANITARY SEWER SYSTEM AND "W" WHEN USED IN WATER SYSTEM.
2. RISER FOR VALVE BOX SHALL MATCH TYPE OF PIPE USED FOR MAIN.
3. CAST IRON SHALL BE 35,000 PSI, ASTM A48 CLASS 35B




DATE: 03/18

CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS


SMALL GATE VALVE BOX
FOR MAINS UP TO 6 INCHES

SCALE:
NOT TO SCALE


DRAWING NO.
CWS 03

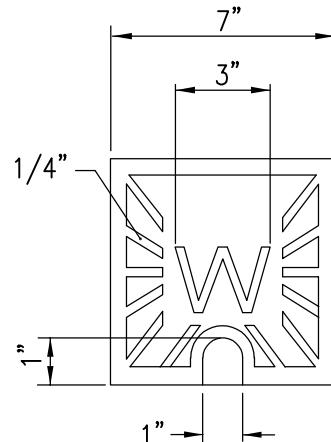

LID TOP PLAN

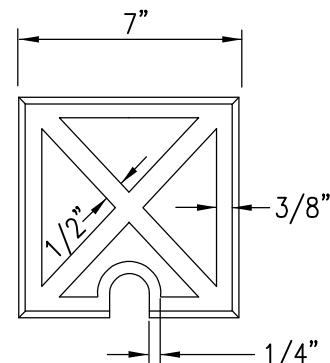

LID BOTTOM PLAN

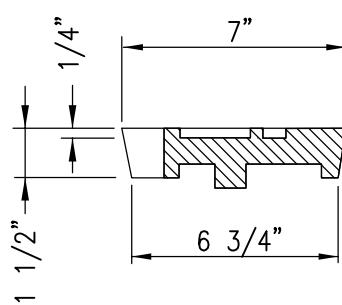

PROFILE