



LID TOP PLAN

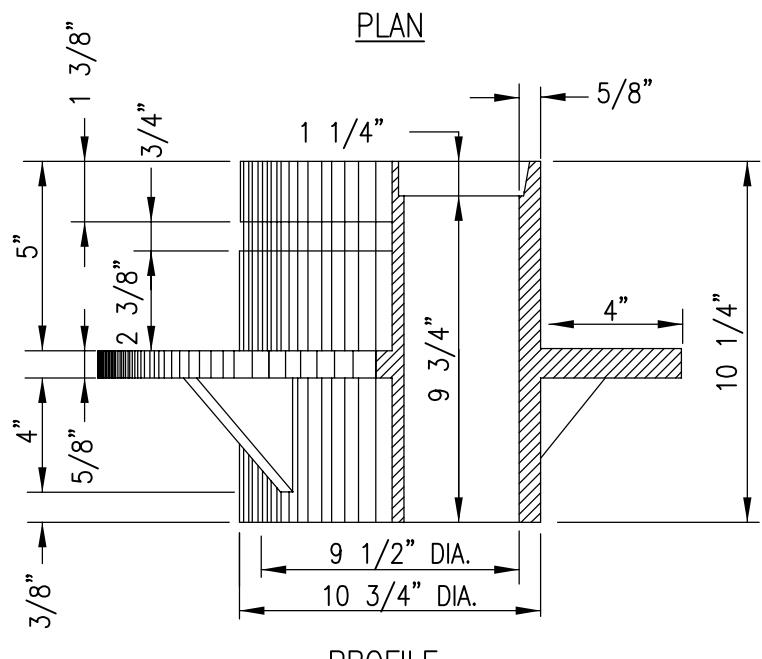

PROFILE

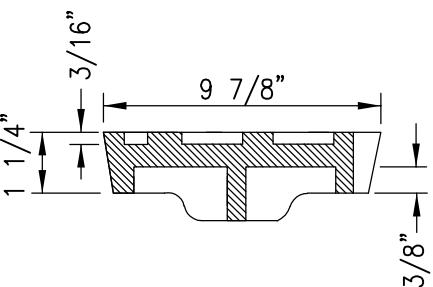

PROFILE

NOTE:

1. LETTER ON COVER SHALL BE "S" WHEN USED IN SANITARY SEWER SYSTEM AND "W" WHEN USED IN WATER SYSTEM.
2. RISER FOR VALVE BOX SHALL MATCH TYPE OF PIPE USED FOR MAIN.
3. CAST IRON SHALL BE 35,000 PSI, ASTM A48 CLASS 35B



CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS

SCALE:
NOT TO SCALE

DATE: 03/18

LARGE VALVE BOX
FOR MAINS 8 INCHES AND LARGER

DRAWING NO.
CWS 04