





TOP VIEW

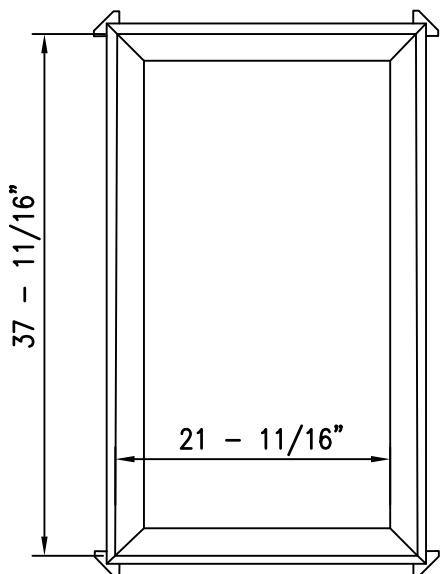


SIDE VIEW

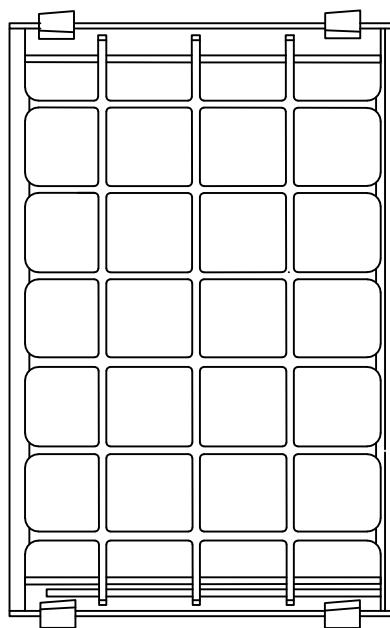

BOTTOM VIEW

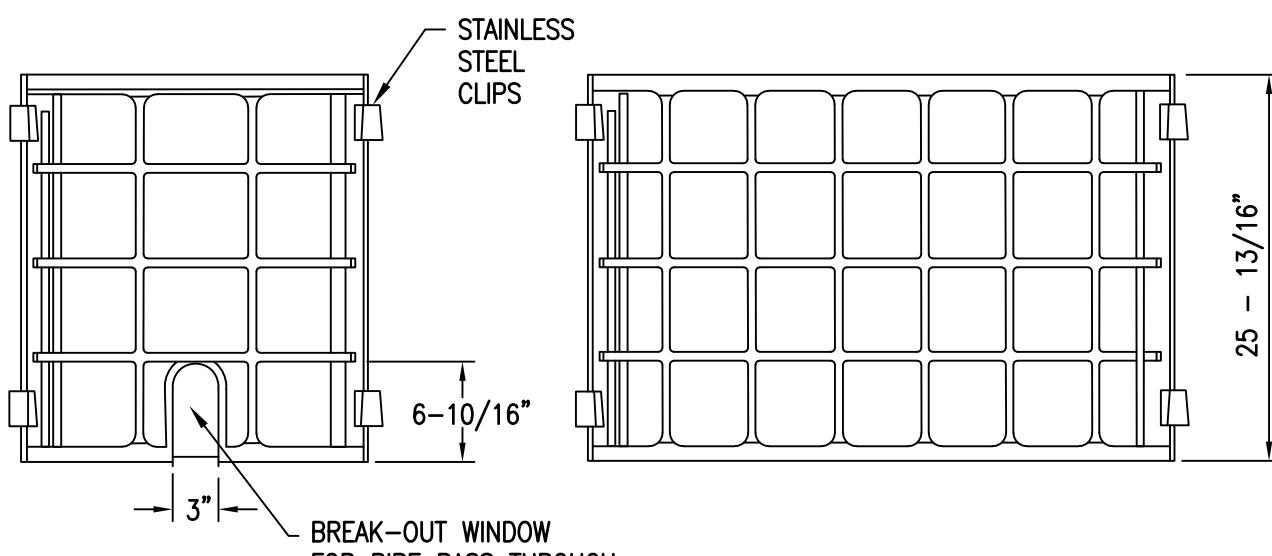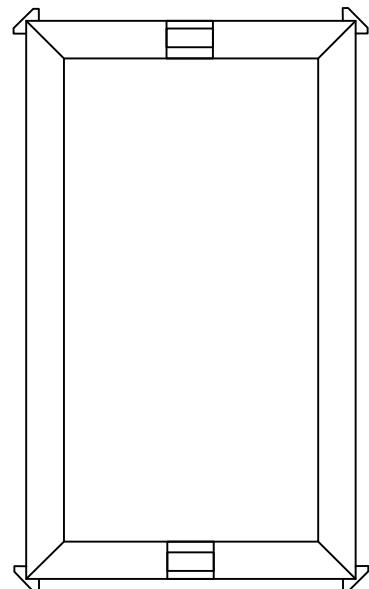NOTES:

1. MATERIAL: HDPE AND STAINLESS STEEL COMPONENTS
2. WATER METER BOX SHALL MEET AASHTO M-306 STANDARDS WITH A MINIMUM RATING OF 30,000 LBS.
3. BOX MANUFACTURER - TRUMBULL, NICOR OR APPROVED EQUAL
4. DIMENSIONAL TOLERANCE $\pm 1/16$ "
5. METER BOX LOCATION SHOULD NOT BE IN OR ADJACENT TO DRIVEWAYS OR ANY AREA SUBJECT TO VEHICLE LOADS.




DATE: 03/24

**CITY OF NORFOLK - DEPARTMENT OF UTILITIES
STANDARD DETAILS**

**1-1/2-INCH TO 2-INCH
WATER METER VAULT**


SCALE:
NOT TO SCALE

DRAWING NO.
CW 05A

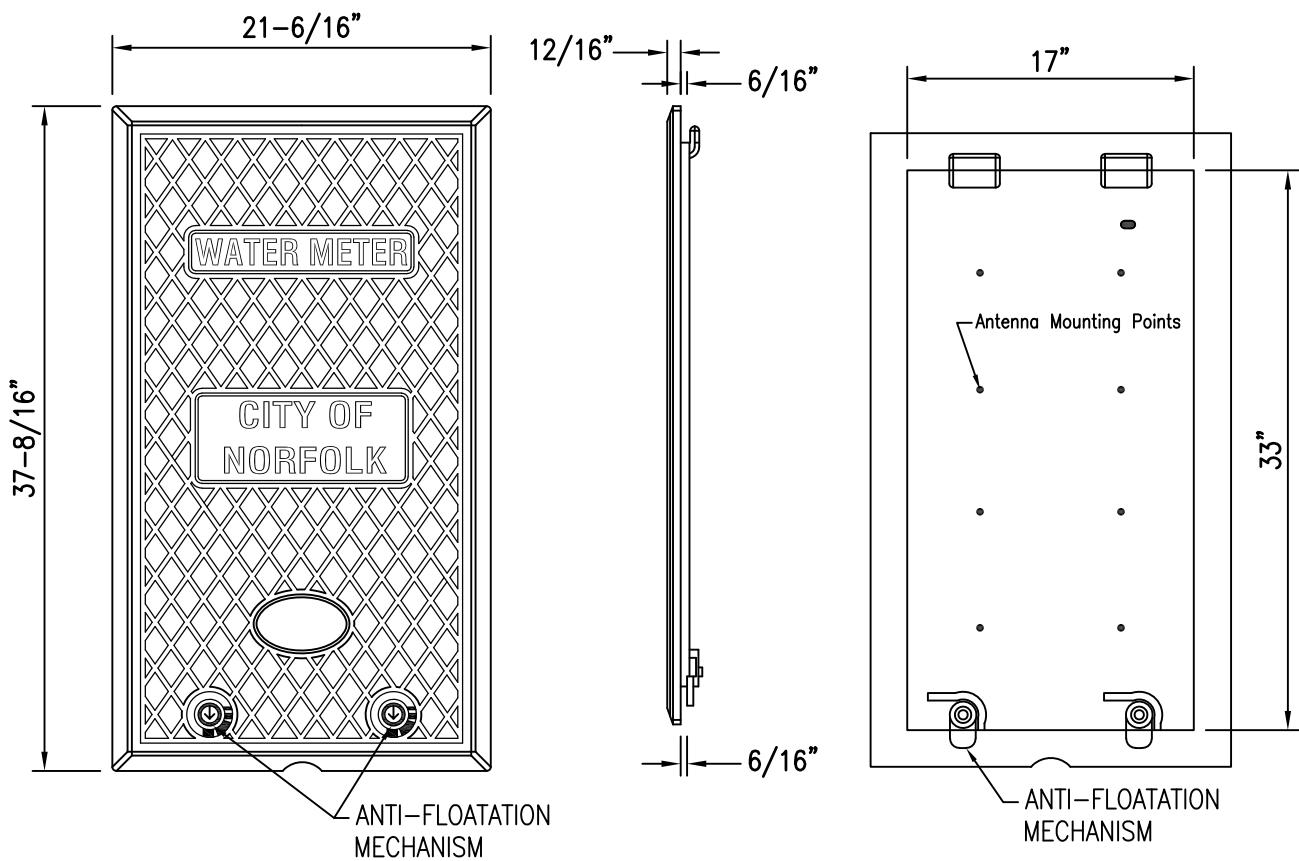

NOTES:

1. MATERIAL: HDPE AND STAINLESS STEEL COMPONENTS.
2. WATER METER LID SHALL BE EQUIPPED WITH AN ANTI-FLOATATION MECHANISM.
3. WATER METER LID SHALL MEET AASHTO M-306 LOADING STANDARDS WITH A MINIMUM RATING OF 40,000 LBS.
4. LID MANUFACTURER – TRUMBULL, NICOR OR APPROVED EQUAL
5. DIMENSIONAL TOLERANCE $\pm 1/16$ "
6. METER LID LOCATION SHOULD NOT BE IN OR ADJACENT TO DRIVEWAYS OR ANY AREA SUBJECT TO VEHICLE LOADS.



DATE: 03/24

CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS

1 1/2-INCH TO 2-INCH
WATER METER VAULT LID

SCALE:
NOT TO SCALE
DRAWING NO.
CW 05B